



	d) connected load is 500 kW and contract demand is 600 kVA
5.	<p>Which of the following is not a part of energy audit as per the Energy Conservation Act, 2001?</p> <p>a) monitoring and analysis of energy use  b) verification of energy use  c) submission of technical report with recommendations  <b>d) ensuring implementation of recommended measures followed by review</b></p>
6.	<p>Which of the following criteria is a responsibility of Designated Consumer?</p> <p>a) designate or appoint an accredited Energy Auditor  <b>b) adhere to stipulated energy consumption norms and standards as notified</b>  c) submit the status of energy consumption information every three years  d) conduct energy audit through a certified energy auditor periodically</p>
7.	<p>Which of the following is an energy security measure?</p> <p>a) fully exploiting domestic energy resources  b) diversifying energy supply source  c) substitution of imported fuels for domestic fuels to the extent possible  <b>d) all of the above</b></p>
8.	<p>Which of the following statements are true?</p> <p>i) reactive current is necessary to build up the flux for the magnetic field of inductive devices  ii) some portion of reactive current is converted into work  iii) the cosine of angle between kVA and kVA<sub>r</sub> vector is called power factor  iv) the cosine of angle between kW and kVA vector is called power factor</p> <p><b>a) i &amp; iv</b>      b) ii &amp; iii      c) i &amp; iii      d) iii &amp; iv</p>
9.	<p>Which of the following statements regarding evacuated tube collectors (ETC) are true?</p> <p>i) ETC is used for high temperatures upto 150°C  ii) because of use of vacuum between two concentric glass tube, higher amount of heat is retained in ETC  iii) heat loss due to conduction back to atmosphere from ETC is high  iv) performance of evacuated tube is highly dependent upon the ambient temperature</p> <p>i &amp; iii      b) ii &amp; iii      c) i &amp; iv      <b>d) i &amp; ii</b></p>

**Paper 1 –Set A with Solutions**

10.	Which among the following has the highest flue gas loss on combustion due to Hydrogen in the fuel?  <b>a) natural gas</b> b) furnace oil      c) coal      d) light diesel oil
11.	Assume CO <sub>2</sub> equivalent emissions by the use of a 60 W incandescent lamp are of the order of 60 g/hr. If it is replaced by a 5 W LED lamp then the equivalent CO <sub>2</sub> emissions will be  a) nil <b>b) 5 g/hr</b> c) 12 g/hr      d) 300 g/hr
12.	The benchmarking parameter for a vapour compression refrigeration system is  a) kW / kg of refrigerant used      b) kcal / m <sup>3</sup> of chilled water c) BTU / Ton of Refrigeration <b>d) kW / Ton of Refrigeration</b>
13.	The rate of energy transfer from a higher temperature to a lower temperature is measured in  a) kcal <b>b) Watt</b> c) Watts per second      d) none of the above.
14.	Energy sources which are inexhaustible are known as  a) commercial energy      b) primary energy <b>c) renewable energy</b> d) secondary energy
15.	1 kg of wood contains 15% moisture and 5% hydrogen by weight. How much water is evaporated during complete combustion of 1kg of wood?  <b>a) 0.6 kg</b> b) 200 g      c) 0.15 kg      d) none of the above
16.	The internal rate of return is the discount rate for which the NPV is a) positive <b>b) zero</b> c) negative      d) less than 1
17.	As per Energy Conservation Act, 2001, a BEE Certified Energy Manger is required to be appointed/designated by the  a) state designated agencies      b) all industrial consumers <b>c) designated consumers</b> d) electrical distribution licensees
18.	The process of capturing CO <sub>2</sub> from point sources and storing them is called _____  <b>a) carbon sequestration</b> b) carbon sink c) carbon capture      d) carbon adsorption
19.	Which of the following has the highest specific heat?  a) lead      b) mercury <b>c) water</b> d) alcohol
20.	The retrofitting of a variable speed drive in a plant costs Rs 2 lakh. The annual savings

## Paper 1 –Set A with Solutions

	<p>is Rs 0.5 lakh. The maintenance cost is Rs. 5,000/year. The return on investment is</p> <p>a) 25%                      <b>b) 22.5%</b>                      c) 24%                      d) 27.5%</p>
21.	<p>_____ is a statistical technique which determines and quantifies the relationship between variables and enables standard equations to be established for energy consumption.</p> <p>a) <b>linear regression analysis</b>                      b) time-dependent energy analysis c) moving annual total                      d) CUSUM</p>
22.	<p>The power generation potential in mini hydro power plant for a water flow of 3 m<sup>3</sup>/sec with a head of 14 meters and with a system efficiency of 55% is</p> <p>a) <b>226.6 kW</b>                      b) 76.4 kW                      c) 23.1 kW                      d) none of the above</p>
23.	<p>Which of the following two statements are true regarding application of Kaizen for energy conservation?</p> <p>i) Kaizen events are structured for reduction of only energy wastes ii) Kaizen events engage workers in such a way so that they get involved in energy conservation efforts iii) Implementation of kaizen events takes place after review and approval of top management iv) In a Kaizen event, it may happen that small change in one area may result in significant savings in overall energy use</p> <p>a) <b>ii &amp; iv</b>                      b) i &amp; iii                      c) iii &amp; iv                      d) i &amp; iv</p>
24.	<p>The electrical power unit Giga Watt (GW) may be written as</p> <p>a) 1,000,000 MW                      <b>b) 1,000 MW</b>                      c) 1,000 kW                      d) 1,000,000 W</p>
25.	<p>The producer gas basically consists of</p> <p>a) Only CH<sub>4</sub>                      b) CO &amp; CH<sub>4</sub>                      <b>c) CO, H<sub>2</sub> &amp; CH<sub>4</sub></b>                      d) Only CO &amp; H<sub>2</sub></p>
26.	<p>Which of the following statements is correct regarding 'float' for an activity?</p> <p>a) Time between its earliest start time and earliest finish time b) Time between its latest start time and latest finish time c) Time between latest start time and earliest finish time <b>d) Time between earliest finish time and latest finish time</b></p>
27.	<p>The Energy Conservation Act,2001 requires that all designated consumers should get energy audits conducted periodically by</p> <p>a) certified energy manager                      b) certified energy auditor</p>

**Paper 1 –Set A with Solutions**

	<b>c) accredited energy auditor</b>	d) state Designated Agencies
28.	The term missing in the following equation $(kVA)^2 = (kVA \cos \phi)^2 + ( ? )^2$ is a) $\cos \phi$ b) $\sin \phi$ <b>c) <math>kVA \sin \phi</math></b> d) $kVArh$	
29.	2000 kJ of heat is supplied to 500 kg of ice at 0°C. If the latent heat of fusion of ice is 335 kJ/kg then the amount of ice in kg melted will be a) 1.49      b) 83.75 <b>c) 5.97</b> d) None of the above	
30.	An electric heater draws 5 kW of power for continuous hot water generation in an industry. How much quantity of water in litres per min can be heated from 30°C to 85°C ignoring losses? <b>a) 1.3</b> b) 78.18      c) 275      d) none of the above	
31.	An electric heater consumes 1000 Joules of energy in 5 seconds. Its power rating is: <b>a) 200 W</b> b) 1000 W      c) 5000W      d) none of the above	
32.	The quantity of heat required to raise the temperature of a given substance by 1 °C is known as: a) sensible heat    b) specific heat <b>c) heat capacity</b> d) latent heat	
33.	Which of the following parameters is not considered for external Bench Marking? a) scale of operation <b>b) energy pricing</b> c) raw materials and product quality      d) vintage of technology	
34.	<b>A sling psychrometer is used to measure :</b> <b>a) only dry bulb temperature</b> <b>b) only wet bulb temperature</b> <b>c) both a &amp; b</b> <b>d) relative humidity</b>	
35.	The number of moles of water contained in 36 kg of water is ----- <b>a) 2</b> b) 3      c) 4      d) 5	
36.	A process electric heater is taking an hour to reach the desired temperature while operating at 440 V. It will take ----- hours to reach the same temperature if the supply voltage is reduced to 220 V. a) 2      b) 3 <b>c) 4</b> d) 5	
37.	In a manufacturing plant, following data are gathered for a given month: Production - 1200 pieces; specific energy consumption - 1000 kWh/piece; variable energy consumption - 950 kWh/piece. The fixed energy consumption of the plant for the month	

Paper 1 –Set A with Solutions

	is ----- a) 6,000 kWh      b) 10,000 kWh      c) 12,000 kWh <b>d) 60,000 kWh</b>
38.	Which of the following GHGs has the longest atmospheric life time? a) CO <sub>2</sub> b) CFC c) Sulfur Hexafluoride (SF <sub>6</sub> ) <b>d) perfluorocarbon (PFC)</b>
39.	The component of electric power which yields useful mechanical power output is known as a) apparent power <b>b) active power</b> c) reactive power      d) none of the above
40.	An oil fired boiler is retrofitted to fire coconut shell chips. Boiler thermal efficiency drops from 82% to 70%. What will be the percentage change in energy consumption to generate the same output a) 12% increase      b) 14.6% increase c) 17.1% decrease <b>d) 17.1% increase</b>
41.	A three phase induction motor is drawing 16 Ampere at 440 Volts. If the operating power factor of the motor is 0.90 and the motor efficiency is 92%, then the mechanical shaft power output of the motor is a) 12.04 kW <b>b) 10.09 kW</b> c) 10.97 kW      d) None of the above
42.	The energy conversion efficiency of a solar cell does not depend on a) solar energy insolation <b>b) inverter</b> c) area of the solar cell      d) maximum power output
43.	To maximize the combustion efficiency, which of the following in the flue gas needs to be done? a) maximize O <sub>2</sub> <b>b) maximize CO<sub>2</sub></b> c) minimize CO <sub>2</sub> d) maximize CO
44.	An indication of sensible heat content in air-water vapour mixture is a) wet bulb temperature      b) dew point temperature c) density of air <b>d) dry bulb temperature</b>
45.	Which of the following is false? a) electricity is high-grade energy b) high grade forms of energy are highly ordered and compact <b>c) low grade energy is better used for applications like melting of metals rather than heating water for bath</b>



	<p>electrical utilities like to have flat demand curve to achieve high plant efficiency.</p> <ul style="list-style-type: none"> <li>➤ ToD tariff encourage user to draw more power during off-peak hours (say during 11pm to 5 am, night time) and less power during peak hours. Energy meter will record peak, off-peak and normal period consumption, separately.</li> <li>➤ TOD tariff gives opportunity for the user to reduce their billing, as off peak hour tariff is quite low in comparison to peak hour tariff.</li> <li>➤ This also helps the power system to minimize in line congestion, in turn higher line losses and peak load incident and utilities power procurement charges by reduced demand</li> </ul> <p style="text-align: right;">.....5 marks ( each point consider 1.5 marks)</p>
S- 2	<p>In a chemical factory where dyes are made, wet cake at 30 °C consisting of 60% moisture is put in a dryer to obtain an output having only 5% moisture, at atmospheric pressure. In each batch about 120 kgs of material is dried.</p> <ol style="list-style-type: none"> <li>a. The quantity of moisture removed per batch.</li> <li>b. What is the total quantity ( sensible &amp; latent) of heat required to evaporate the moisture, if the latent heat of water is 540 kcal/kg at atmospheric conditions, Ignore heat absorbed by the solids</li> <li>c. Find the quantity of steam required for the drying process (per batch), if steam at 4 kg/cm<sup>2</sup> is used for generating hot air in the dryer and the dryer efficiency is 80%. Latent heat of steam at 4 kg/cm<sup>2</sup> is 520 kcal/kg.</li> </ol>
Ans	<p>Given that</p> <ul style="list-style-type: none"> <li>• Qty of material dried per batch - 120 Kgs</li> <li>• Moisture at inlet - 60%</li> </ul> <p>a. The quantity of moisture removed per batch.</p> <ul style="list-style-type: none"> <li>• Water quantity in a wet batch - <math>120 \times 0.6 = 72</math> Kgs.</li> <li>• Quantity of bone dry material - <math>120 - 72 = 48</math> Kgs.</li> <li>• Moisture at outlet - 5%</li> <li>• Total weight of dry batch output - <math>48/0.95 = 50.5</math> Kgs.</li> <li>• Equivalent water in a dry batch - <math>50.5 - 48 = 2.5</math> Kgs.</li> </ul>

	<p>• Total water removed in drying - <math>72 - 2.5 = 69.5</math> Kgs./batch  .....1.5 marks</p> <p>b. The total quantity of heat required to evaporate the moisture.</p> <p>To evaporate the moisture at atmospheric pressure, the material has to be first heated up to <math>100^{\circ}\text{C}</math>.</p> <p>The total heat required would be;</p> <p>Sensible heat - <math>72 \times 1 \times (100 - 30) = 5040</math> Kcal/batch  Latent heat - <math>69.5 \times 540 = 37530</math> Kcal/batch  Total heat required - <math>5040 + 37530 = 42570</math> Kcal/batch  .....2 marks</p> <p>c. The quantity of steam required for the drying process</p> <p>Dryer Efficiency - 80%  Heat input to dryer - <math>42570/0.8 = 53212.50</math> Kcal/batch  Latent heat in 4 Kg/cm<sup>2</sup> steam - 520 Kcal/Kg  Steam quantity required - <math>53212.50 / 520 = 102.3</math> Kgs / batch  .....1.5 marks</p>
<p><b>S-3</b></p>	<p>Explain PAT scheme and why it is a market based mechanism?</p>
<p>Ans</p>	<p>Perform, Achieve and Trade (PAT) Scheme is a market based mechanism to enhance cost effectiveness of improvements in energy efficiency in energy-intensive large industries and facilities, through certification of energy savings that could be traded. The genesis of the PAT mechanism flows out of the provision of the Energy Conservation Act, 2001 (amended in 2010).</p> <p>The key goal of PAT scheme is to mandate specific energy efficiency improvements for the most energy intensive industries in sectors as listed below.</p> <p><b>Sector</b></p> <ol style="list-style-type: none"> <li>1. Aluminium</li> <li>2. Cement</li> <li>3. Chlor-Alkali</li> <li>4. Fertilizer</li> <li>5. Iron and Steel</li> <li>6. Pulp and Paper</li> <li>7. Textile</li> <li>8. Thermal Power Plant</li> </ol>

	<p>The energy intensity reduction target mandated for each unit is depended on its operating efficiency and the specific energy consumption reduction target is less for those who are more efficient and more for the less efficient units.</p> <p>Further, the scheme incentivizes units to exceed their specified SEC improvement targets. To facilitate this, the scheme provides the option for industries who achieve superior savings to receive energy savings certificates for this excess savings, and to trade the additional certified energy savings certificates with other designated consumers who can utilize these certificates to comply with their specific energy consumption reduction targets. Energy Savings Certificates (ESCerts) so issued will be tradable at Power Exchanges. The scheme also allows units which gain ESCerts to bank them for the next cycle of PAT, following the cycle in which they have been issued. The number of ESCerts which would be issued would depend on the quantum of energy saved over and above the target energy savings in the assessment year.</p> <p>After completion of baseline audits, targets varying from unit to unit ranging from about 3 to 7% are set and need to be accomplished during the 3 year cycle; after which new cycle with new targets will be proposed. Failing to achieve the specific energy consumption targets in the time frame would attract penalty for the non-compliance under Section 26 (1A) of the Energy Conservation Act, 2001 (amended in 2010). For ensuring the compliance with the set targets, system of verification and check-verification will be carried out by empanelment criteria of accredited energy auditors.</p> <p style="text-align: right;">.....5 marks</p> <p><b>Refer Book 1: Pg no 40-41</b></p>
<b>S-4</b>	Give a short description about Availability Based Tariff (ABT).
Ans	<p>Introduction of availability based tariff(ABT) and scheduled interchange charges for power was introduced in 2003 for interstate sale of power , have reduced voltage and frequency fluctuation</p> <ul style="list-style-type: none"> <li>• It is a performance-based tariff system for the supply of electricity by generators owned and controlled by the central government.</li> <li>• It is also a new system of scheduling and dispatch, which requires both generators and beneficiaries to commit to day - ahead schedule.</li> <li>• It is a system of rewards and penalties seeking to enforce day ahead pre-committed schedules, though variations are permitted if notified one and a half hours in advance.</li> <li>• The order emphasizes prompt payment of dues , non-payment of prescribed charges will be liable for appropriate action.</li> </ul> <p style="text-align: right;">.....5 marks</p>


<p><b>S –5</b></p>	<p>In a heat treatment shop, steel components are heat-treated in batches of 80 Tons. The heat treatment cycle is as follows;</p> <ul style="list-style-type: none"> <li>• Increase temperature from 30 °C to 850 °C in 3 hours.</li> <li>• Maintain 850 °C for 1 hour (soaking time).</li> <li>• Cool the material to 60 °C in 4 hours.</li> </ul> <p>a) Calculate the efficiency of the furnace, if the specific heat of steel is 0.12 kcal/kg<sup>o</sup>C and fuel oil consumption per batch is 1400 litres.</p> <ul style="list-style-type: none"> <li>• GCV of fuel oil - 10200 kcal/kg,</li> <li>• Cost of fuel oil - Rs. 46,000/kL,</li> <li>• Sp. gr. of fuel oil - 0.92.</li> </ul> <p>b) Due to high cost of oil, the plant management decides to convert to a lower operating cost LPG fired furnace lined on the inside with ceramic fibre insulation and with an operating efficiency of 80%, for same requirement. The investment towards installation of the new furnace is Rs. 50 lakhs. Calculate the Return on Investment, if the plant operates two batches per day and 250 days in a year.</p> <ul style="list-style-type: none"> <li>• Cost of LPG - Rs. 75/kg,</li> <li>• GCV of LPG - 12500 kcal/kg.</li> </ul>																																						
<p><b>Ans</b></p>	<table style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 60%;"><b>Quantity of steel treated per batch</b></td> <td style="width: 10%; text-align: center;">-</td> <td style="width: 30%;"><b>80 Tons</b></td> </tr> <tr> <td colspan="3"> </td> </tr> <tr> <td colspan="3"><b>a. Efficiency of Furnace:</b></td> </tr> <tr> <td style="padding-left: 20px;">Useful heat supplied to steel</td> <td style="text-align: center;">-</td> <td>80000 x 0.12 x (850 – 30) = 7872000 kcal/batch</td> </tr> <tr> <td></td> <td></td> <td style="text-align: right;">.....1 mark</td> </tr> <tr> <td style="padding-left: 20px;">Total heat supplied by fuel</td> <td style="text-align: center;">-</td> <td>1400 x 0.92 x 10200 = 13137600 kcal/batch</td> </tr> <tr> <td style="padding-left: 20px;">Efficiency of Furnace</td> <td style="text-align: center;">-</td> <td>7872000/12067824 = 59.9%</td> </tr> <tr> <td></td> <td></td> <td style="text-align: right;">.....1 mark</td> </tr> <tr> <td colspan="3"><b>b. Return on Investment (RoI):</b></td> </tr> <tr> <td style="padding-left: 20px;">Cost of operating fuel oil furnace</td> <td style="text-align: center;">-</td> <td>1400 x 46 = Rs. 64400/batch</td> </tr> <tr> <td style="padding-left: 20px;">Efficiency of new LPG furnace</td> <td style="text-align: center;">-</td> <td>80%</td> </tr> <tr> <td style="padding-left: 20px;">Heat supplied in new LPG furnace</td> <td style="text-align: center;">-</td> <td>7872000/0.8</td> </tr> </table>			<b>Quantity of steel treated per batch</b>	-	<b>80 Tons</b>	 			<b>a. Efficiency of Furnace:</b>			Useful heat supplied to steel	-	80000 x 0.12 x (850 – 30) = 7872000 kcal/batch			.....1 mark	Total heat supplied by fuel	-	1400 x 0.92 x 10200 = 13137600 kcal/batch	Efficiency of Furnace	-	7872000/12067824 = 59.9%			.....1 mark	<b>b. Return on Investment (RoI):</b>			Cost of operating fuel oil furnace	-	1400 x 46 = Rs. 64400/batch	Efficiency of new LPG furnace	-	80%	Heat supplied in new LPG furnace	-	7872000/0.8
<b>Quantity of steel treated per batch</b>	-	<b>80 Tons</b>																																					
<b>a. Efficiency of Furnace:</b>																																							
Useful heat supplied to steel	-	80000 x 0.12 x (850 – 30) = 7872000 kcal/batch																																					
		.....1 mark																																					
Total heat supplied by fuel	-	1400 x 0.92 x 10200 = 13137600 kcal/batch																																					
Efficiency of Furnace	-	7872000/12067824 = 59.9%																																					
		.....1 mark																																					
<b>b. Return on Investment (RoI):</b>																																							
Cost of operating fuel oil furnace	-	1400 x 46 = Rs. 64400/batch																																					
Efficiency of new LPG furnace	-	80%																																					
Heat supplied in new LPG furnace	-	7872000/0.8																																					

		= 9840000 kcal/batch	
Equivalent LPG consumption	-	9840000/12500	
		= 787.2 kg/batch	
		.....1 mark	
Cost of operating LPG Furnace	-	787.2 x 75	
		=Rs. 59040/batch	
Cost saving per batch	-	64400 – 59040 =Rs. 5360/-	
Annual cost saving	-	5360 x 2 x 250	
		=Rs. 26,80,000/-	
		.....1 mark	
Investment for new furnace	-	Rs. 50 Lakhs	
Return on Investment (RoI)	-	(26.8/50)*100 = 53.6%	
		.....1 mark	

S – 6

In a 100 TPD Sponge Iron plant, the sponge iron is fed to the Induction melting furnace, producing molten steel at 88% yield. The Energy consumption details are as follows:

- Coal Consumption : 130 TPD
- GCV of coal : 4500 kcal/kg
- Power Purchased from Grid : 82400 kWh / day
- Specific Energy consumption for Kiln producing Sponge Iron: 120 kWh / ton sponge iron

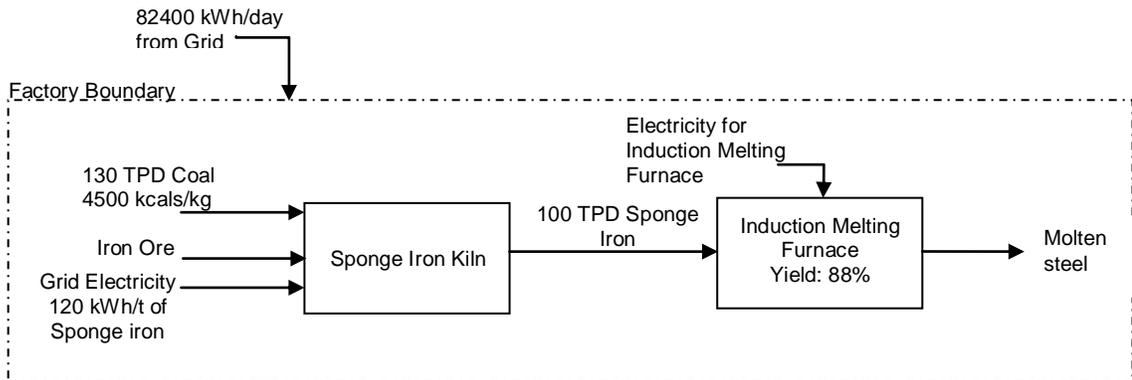

Calculate the following

1. Specific Energy Consumption of Induction melting furnace in terms of kWh/ton of molten steel
2. Specific Energy Consumption of the entire plant, in terms of kcal/kg of molten steel (product).
3. Total Energy Consumption of Plant in Tons of Oil Equivalent (TOE )

<p>Ans</p>	<p>a) Specific Energy Consumption of Induction Melting Furnace</p> <p>Molten Steel Production from the Induction melting furnace per day</p> $= 100 \times 88/100 = 88 \text{ TPD}$ <p>Total Energy Consumption of the Plant = 82400 kWh</p> <p>Electrical Energy Consumption in Sponge Iron Making = 120 x 100 = 12000 kWh per day</p> <p>Electrical Energy Consumption in Induction Melting Furnace = 82400-12000 = 70400 kWh/day .....1 mark</p> <p><b>Specific Energy Consumption of Induction Melting Furnace= 70400 / 88</b> <b>= 800 kWh/ton of molten steel</b> .....1 mark</p> <p>b) Total Energy Consumption of the Plant:</p> $(82400 \times 860) + (130 \times 1000 \times 4500) = (70864000 + 585000000)$ $= 655864000 \text{ kcal/day}$ <p>.....1 mark</p> <p>Specific Energy Consumption in terms of kcal/kg of Molten metal <b>= 655864000 / 88000 = 7453 kcal/kg of molten metal</b> .....1 mark</p> <p>c) Total Energy consumption of Plant in ToE</p> $= 655864000 / 10^7 = 65.586 \text{ ToE}$ <p>.....1 mark</p>
<p>S- 7</p>	<p>A manufacturing industry plans to improve its energy performance under PAT through implementation of an energy conservation scheme. After implementation, calculate the Plant Energy Performance (PEP) with 2015-16 as the reference year. What is your inference?</p> <p>Given that:</p> <ul style="list-style-type: none"> <li>• The current year (2016-17 ) Annual Production – 28,750 T ,</li> <li>• Current year (2016-17 ) Annual Energy Consumption– 23,834 MWh,</li> <li>• Reference year (2015-16 ) production - 34,000 T,</li> <li>• Reference year (2015-16 ) Energy consumption - 27,200 MWh.</li> </ul>
<p>Ans</p>	<p>Production factor (PF) = 28750/34000 = 0.846 .....1 mark</p> <p>Ref year equivalent energy (RYEE) = Ref Year Energy Use (RYEU) x PF = 27,200 x 0.846 = 23011 MWh</p>

**Paper 1 –Set A with Solutions**

	<p align="right">.....1 mark</p> <p>PEP = (RYEE – current year energy)/RYEE = (23011 – 23834)/23011 = (-) 0.0369 ie (-) 3.7 %</p> <p align="right">.....1.5 marks</p> <p>Since the PEP is negative, it implies that the energy conservation measure did not yield reduction in energy consumption, action to be taken to improve the plant performance.</p> <p align="right">.....1.5 marks</p>
S-8	List down any five Designated Consumers notified under the Energy Conservation Act.
Ans	<p>(1) Aluminium, (2) Cement, (3) Chloralkali, (4) Fertiliser, (5) Steel, (6) Pulp &amp; Paper, (7) Thermal Power Plants, (8) Textile, (9) Railways.</p> <p align="right">.....5 marks ( any 5 of the above and each one carries one mark)</p>

..... **End of Section – II** .....

**Section – III: LONG DESCRIPTIVE QUESTIONS**

**Marks: 6 x 10 = 60**

- (i) Answer all **Six** questions
- (ii) Each question carries **Ten** marks

L - 1	<p>Saturated steam at 1 atm is discharged from a turbine at 1200 kg/h. Superheated steam at 300 °C and 1 atm is needed as a feed to a heat exchanger. To produce it, the turbine discharge stream is mixed with superheated steam at 400 °C, 1 atm and specific volume of 3.11 m<sup>3</sup>/kg. Calculate the amount of superheated steam at 300 °C produced and the volumetric flow rate of the 400 °C steam.</p> <div style="border: 1px solid black; padding: 10px; margin: 10px 0;"> <table style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 30%; vertical-align: top;"> <p><b>Turbine Discharge steam</b> H - 2676 kJ/kg, Q - 1200 kg/h, P-1atm, T-110°C.</p> <p><b>Super heated steam</b> H - 3278 kJ/kg, Q – m<sub>1</sub> kg/h, P-1atm, T-400°C.</p> </td> <td style="width: 30%; text-align: center; vertical-align: middle;"> <div style="border: 2px solid blue; border-radius: 20px; padding: 10px; display: inline-block;"> <p style="margin: 0;">M I X I N G</p> </div> </td> <td style="width: 40%; vertical-align: middle;"> <p align="center"><b>Mixed Super heated steam to HEx</b></p> <p align="right">H - 3074 kJ/kg, Q – m<sub>2</sub> kg/h, P-1atm, T-300°C.</p> </td> </tr> </table> </div>	<p><b>Turbine Discharge steam</b> H - 2676 kJ/kg, Q - 1200 kg/h, P-1atm, T-110°C.</p> <p><b>Super heated steam</b> H - 3278 kJ/kg, Q – m<sub>1</sub> kg/h, P-1atm, T-400°C.</p>	<div style="border: 2px solid blue; border-radius: 20px; padding: 10px; display: inline-block;"> <p style="margin: 0;">M I X I N G</p> </div>	<p align="center"><b>Mixed Super heated steam to HEx</b></p> <p align="right">H - 3074 kJ/kg, Q – m<sub>2</sub> kg/h, P-1atm, T-300°C.</p>
<p><b>Turbine Discharge steam</b> H - 2676 kJ/kg, Q - 1200 kg/h, P-1atm, T-110°C.</p> <p><b>Super heated steam</b> H - 3278 kJ/kg, Q – m<sub>1</sub> kg/h, P-1atm, T-400°C.</p>	<div style="border: 2px solid blue; border-radius: 20px; padding: 10px; display: inline-block;"> <p style="margin: 0;">M I X I N G</p> </div>	<p align="center"><b>Mixed Super heated steam to HEx</b></p> <p align="right">H - 3074 kJ/kg, Q – m<sub>2</sub> kg/h, P-1atm, T-300°C.</p>		
Ans	<p><b>Solution</b></p> <p><b>1. Mass balance of water</b> 1200 + m<sub>1</sub> = m<sub>2</sub> ..... (1)</p> <p align="right">.....1 mark</p> <p><b>2. Energy balance</b> (1200 kg/h)(2676 kJ/kg) + m<sub>1</sub>(3278 kJ/kg)</p>			

$= m_2(3074 \text{ kJ/kg}) \dots\dots\dots (2)$   
 .....1 mark

Eqs. (1) and (2) are solved simultaneously  
 $3211200 + 3278m_1 = (1200 + m_1)3074$   
 $m_1 = 2341.2 \text{ kg/h}$   
 $m_2 = 1200 + 2341.2 = 3541.2 \text{ kg/h (superheated steam produced)}$   
 .....4 marks

**3. Volumetric flow rate of 400°C steam**  
 The specific volume of steam at 400 C and 1 atm is  $3.11 \text{ m}^3/\text{kg}$ . The volumetric flow rate is calculated as follows:  
 $(2341.2 \text{ kg/h})(3.11 \text{ m}^3/\text{kg})$   
 $= 7281.1 \text{ m}^3/\text{h}$   
 .....4 marks

**L –2** The energy consumption and production patterns in a chemical plant over a 9 month period is provided in the table below;

Month	1	2	3	4	5	6	7	8	9
Production in Tonnes / month	493	297	381	479	585	440	234	239	239
Energy Consumption MWh /month	78.2	75.7	76.3	76.1	78.1	70.7	73.7	64.4	72.1

Estimate the cumulative energy savings at end of the 9<sup>th</sup> month and give your inference on the result ? ( consider 9 month data for evaluation for predicted energy consumption)

**Ans** It is required to use the equations  $Y = mX + C$  and  
 $nC + m\sum X = \sum Y$   
 $c\sum X + m\sum X^2 = \sum XY$

Month	X = Production in Tonnes / month	Y =Energy Consumption MWh /month	X <sup>2</sup>	XY
1	493	78.2	243049	38574.12
2	297	75.7	88209	22479.51
3	381	76.3	145161	29076.88
4	479	76.1	229441	36436.09
5	585	78.1	342225	45671.42
6	440	70.7	193600	31110.53
7	234	73.7	54756	17240.63
8	239	64.4	57121	15402.96
9	239	72.1	57121	17228.98
	<b>3387</b>	<b>665.3</b>	<b>1410683</b>	<b>253221</b>

Therefore, the normal equations become;

$$9c + 3387m = 665.3 \quad \dots\dots\dots i$$

$$3387C + 1410683m = 253221.1 \quad \dots\dots\dots ii$$

.....2 marks

$$c = (665.3-3387m)/9$$

Substituting in Eq. ii,

$$m = 0.021 \quad \text{and}$$

$$c = 66.1$$

The best-fit straight line equation is;

$$y = 0.021x + 66.1$$

.....3 marks

Month	Production in Tonnes / month x	E <sub>actual</sub>	E <sub>cal</sub> Y = 0.021x + 66.1	Difference	CUSUM
1	493	78.2	76.45	1.75	1.75
2	297	75.7	72.34	3.36	5.11
3	381	76.3	74.10	2.20	7.31
4	479	76.1	76.16	-0.06	7.25
5	585	78.1	78.39	-0.28	6.97
6	440	70.7	75.34	-4.64	2.33
7	234	73.7	71.01	2.69	5.01
8	239	64.4	71.12	-6.72	-1.71
9	239	72.1	71.12	0.98	-0.73

.....4 marks

Since the CUSUM value at the end of 9<sup>th</sup> month is negative, the plant has not achieved any net energy savings and action has to be taken to determine reason for no performance of the encon option.

.....1 mark

L - 3

Explain the following

- a) Dry Bulb Temperature and Wet bulb Temperature
- b) Maximum Demand and Power Factor
- c) Gross Calorific Value & Net Calorific Value
- d) 5S & Return of Investment (ROI)
- e) CUSUM

Ans	<p>a) Dry Bulb Temperature and Wet bulb Temperature</p> <ul style="list-style-type: none"> <li>• Dry bulb Temperature is an indication of the sensible heat content of air-water vapour mixtures</li> <li>• Wet bulb Temperature is a measure of total heat content or enthalpy. It is the temperature approached by the dry bulb and the dew point as saturation occurs.</li> </ul> <p style="text-align: right;">.....2 marks</p> <p>b) Maximum Demand and Power Factor</p> <ul style="list-style-type: none"> <li>• Maximum demand is maximum KVA or KW over one billing cycle</li> <li>• Power Factor <math>\cos \theta = \text{kW} / \text{KVA}</math> or <math>\text{kW} = \text{kVA} \cos \theta</math></li> </ul> <p style="text-align: right;">.....2 marks</p> <p>c) Gross Calorific Value &amp; Net calorific Value:</p> <ul style="list-style-type: none"> <li>• Gross calorific value assumes all vapour produced during the combustion process is fully condensed.</li> <li>• Net calorific value assumes the water leaves with the combustion products without being fully condensed.</li> <li>• The difference being the latent heat of condensation of the water vapour produced during the combustion process.</li> </ul> <p style="text-align: right;">.....2 marks</p> <p><b>d) 5S:</b></p> <p><b>Housekeeping.</b> Separate needed items from unneeded items. Keep only what is immediately necessary item on the shop floor.</p> <p><b>Workplace Organization.</b> Organize the workplace so that needed items can be easily and quickly accessed. A place for everything and everything in its place.</p> <p><b>Cleanup.</b> Sweeping, washing, and cleaning everything around working area immediately.</p> <p><b>Cleanliness.</b> Keep everything clean in a constant state of readiness.</p> <p><b>Discipline.</b> Everyone understands, obeys, and practices the rules when in the plant.</p> <p style="text-align: right;">.....1 mark( any one of the above is sufficient)</p> <p><b>d) Return on Investment:</b></p> <p>ROI expresses the annual return from project as % of capital cost.</p> <p>This is a broad indicator of the annual return expected from initial capital investment,</p>
-----	--

expressed as a percentage.

.....1 mark

**e) Cumulative Sum (CUSUM) Technique:**

- Difference between expected or standard consumption with actual consumption data points over baseline period of time.
- Follows a fixed trend unless something (energy saving measure, deterioration in performance..) happens
- Helps calculation of savings/losses till date after changes

.....2 marks

L – 4 Answer the following

S. No	Statement	Chose the correct answer OR Fill-in-the-blanks
1	Fyrite measures CO <sub>2</sub> , O <sub>2</sub> and SO <sub>2</sub>	True/False
2	Ultrasonic Flow Meter uses the principle of ____ & ____	Fill in the blanks
3	Non Contact Infrared Thermometer cannot measure temperature of objects placed in hazardous places	True/False
4	To measure the RPM of a Flywheel, _____ type of RPM meter is used and for a visible shaft-end _____ type of RPM meter is used.	Fill in the blanks
5	In a switch yard, _____ instrument is used to identify the loose joints and terminations	Fill in the blanks
6	Every Designated Consumer shall have its first energy audit conducted by _____ Energy Auditor within _____ months of notification issued by the Central Government	Fill in the blanks
7	280 kcal/ hr is equivalent to _____ Watts and 3.5 bar is equivalent to _____ kPa	Fill in the blanks
8	One metric ton of oil equivalent is to _____ MW	Fill in the blanks
9	1 kg of Coal, consisting of 30% of Carbon produces _____ kg of CO <sub>2</sub>	Fill in the blanks

**Paper 1 –Set A with Solutions**

	10	In a gasification system the reduction zone is above the combustion zone	True/False	
Ans	<b>Sr No</b>	<b>Statement</b>	<b>Chose the correct answer OR Fill-in-the-blanks</b>	<b>Solution</b>
	1	Fyrite measures CO <sub>2</sub> , O <sub>2</sub> and SO <sub>2</sub>	True/False	False
	2	Ultrasonic Flow Meter uses the principle of ____ & ____	Fill in the blanks	Transit Time; Doppler Effect
	3	Non Contact Infrared Thermometer cannot measure temperature of objects placed in hazardous places	True/False	False
	4	To measure the RPM of a Flywheel, _____ type of RPM meter is used and for a visible shaft-end _____ type of RPM meter is used.	Fill in the blanks	Stroboscope; Tachometer
	5	In a switch yard, _____ instrument is used to identify the loose joints and terminations	Fill in the blanks	Thermal imager or IR gun
	6	Every Designated Consumer shall have its first energy audit conducted by _____ Energy Auditor within _____ months of notification issued by the Central Government	Fill in the blanks	Accredited ; 18 months
	7	280 kcal/ hr is equivalent to _____ Watts and 3.5 bar is equivalent to _____ kPa	Fill in the blanks	325.6 Watts; (280x4.187x1000/3600) 350 kPa (3.5 x100)
	8	One metric ton of oil equivalent is to _____ MW	Fill in the blanks	11.62 MW (1x1000x10000/(860x1000))
	9	1 kg of Coal, consisting of 30% of Carbon produces _____ kg of CO <sub>2</sub>	Fill in the blanks	1.1 [(44/12)x(0.3)]
	10	In a gasification system the reduction zone is above the combustion zone	True/False	False

## Paper 1 –Set A with Solutions

	.....10 marks(each one carries one mark)
L - 5	<p>A company has to choose between two projects whose cash flows are as indicated below;</p> <p>Project 1:</p> <ul style="list-style-type: none"><li>i. Investment – Rs. 15 Lakhs</li><li>ii. Annual cost savings – Rs. 4 lakhs.</li><li>iii. Bi-annual maintenance cost – Rs. 50,000/-</li><li>iv. Reconditioning and overhaul during 5<sup>th</sup> year: 6 lakhs</li><li>v. Life of the project – 8 years</li><li>vi. Salvage value – Rs. 5 lakhs</li></ul> <p>Project 2:</p> <ul style="list-style-type: none"><li>vii. Investment – Rs. 14 Lakhs</li><li>viii. Annual cost savings – Rs. 3.5 lakhs.</li><li>ix. Annual Maintenance cost – Rs. 20,000/-</li><li>x. Reconditioning and overhaul during 4th year: 5 lakhs</li><li>xi. Life of the project – 8 years</li><li>xii. Salvage Value- 2 lakhs</li></ul> <p>Which project should the company choose? The annual discount rate is 12%.</p>

**Paper 1 –Set A with Solutions**


Ans	<table border="1" style="width:100%; border-collapse: collapse; text-align: center;"> <thead> <tr> <th rowspan="2">Year</th> <th colspan="3">Project 1</th> <th colspan="3">Project 2</th> </tr> <tr> <th>Outgo</th> <th>Saving</th> <th>NPV</th> <th>Outgo</th> <th>Saving</th> <th>NPV</th> </tr> </thead> <tbody> <tr> <td>0</td> <td>15.0</td> <td>0</td> <td>=-15.0</td> <td>14.0</td> <td>0</td> <td>= -14</td> </tr> <tr> <td>1</td> <td>0</td> <td>4.0</td> <td><math>= (4 / (1+.12)^1</math> <math>= 3.571</math></td> <td>0.2</td> <td>3.5</td> <td><math>= (3.3 / (1+.12)^1</math> <math>= 2.95</math></td> </tr> <tr> <td>2</td> <td>0.5</td> <td>4.0</td> <td><math>= (3.5 / (1+.12)^2</math> <math>= 2.79</math></td> <td>0.2</td> <td>3.5</td> <td><math>= (3.3 / (1+.12)^2</math> <math>= 2.63</math></td> </tr> <tr> <td>3</td> <td>0</td> <td>4.0</td> <td><math>= (4 / (1+.12)^3</math> <math>= 2.84</math></td> <td>0.2</td> <td>3.5</td> <td><math>= (3.3 / (1+.12)^3</math> <math>= 2.35</math></td> </tr> <tr> <td>4</td> <td>0.5</td> <td>4.0</td> <td><math>= (3.5 / (1+.12)^4</math> <math>= 2.22</math></td> <td>5</td> <td>3.5</td> <td><math>= (-1.5 / (1+.12)^4</math> <math>= -0.95</math></td> </tr> <tr> <td>5</td> <td>6</td> <td>4.0</td> <td><math>= (-2 / (1+.12)^5</math> <math>= -1.13</math></td> <td>0.2</td> <td>3.5</td> <td><math>= (3.3 / (1+.12)^5</math> <math>= 1.87</math></td> </tr> <tr> <td>6</td> <td>0.5</td> <td>4.0</td> <td><math>= (3.5 / (1+.12)^6</math> <math>= 1.77</math></td> <td>0.2</td> <td>3.5</td> <td><math>= (3.3 / (1+.12)^6</math> <math>= 1.67</math></td> </tr> <tr> <td>7</td> <td>0</td> <td>4.0</td> <td><math>= (4 / (1+.12)^7</math> <math>= 1.81</math></td> <td>0.2</td> <td>3.5</td> <td><math>= (3.3 / (1+.12)^7</math> <math>= 1.49</math></td> </tr> <tr> <td>8</td> <td>0.5</td> <td>9 (4+5)</td> <td><math>= (8.5 / (1+.12)^8</math> <math>= 3.43</math></td> <td>0.2</td> <td>5.5 (3.5+2)</td> <td><math>= (5.3 / (1+.12)^8</math> <math>= 2.14</math></td> </tr> <tr> <td>NPV</td> <td></td> <td></td> <td>= + 2.301</td> <td>@12%</td> <td></td> <td>= + 0.15</td> </tr> </tbody> </table> <p style="margin-top: 10px;"><b>NPV Project 1 is higher than Project 2. Hence project 1 is preferred.</b></p> <p align="right">.....10 marks</p>	Year	Project 1			Project 2			Outgo	Saving	NPV	Outgo	Saving	NPV	0	15.0	0	=-15.0	14.0	0	= -14	1	0	4.0	$= (4 / (1+.12)^1$ $= 3.571$	0.2	3.5	$= (3.3 / (1+.12)^1$ $= 2.95$	2	0.5	4.0	$= (3.5 / (1+.12)^2$ $= 2.79$	0.2	3.5	$= (3.3 / (1+.12)^2$ $= 2.63$	3	0	4.0	$= (4 / (1+.12)^3$ $= 2.84$	0.2	3.5	$= (3.3 / (1+.12)^3$ $= 2.35$	4	0.5	4.0	$= (3.5 / (1+.12)^4$ $= 2.22$	5	3.5	$= (-1.5 / (1+.12)^4$ $= -0.95$	5	6	4.0	$= (-2 / (1+.12)^5$ $= -1.13$	0.2	3.5	$= (3.3 / (1+.12)^5$ $= 1.87$	6	0.5	4.0	$= (3.5 / (1+.12)^6$ $= 1.77$	0.2	3.5	$= (3.3 / (1+.12)^6$ $= 1.67$	7	0	4.0	$= (4 / (1+.12)^7$ $= 1.81$	0.2	3.5	$= (3.3 / (1+.12)^7$ $= 1.49$	8	0.5	9 (4+5)	$= (8.5 / (1+.12)^8$ $= 3.43$	0.2	5.5 (3.5+2)	$= (5.3 / (1+.12)^8$ $= 2.14$	NPV			= + 2.301	@12%		= + 0.15
Year	Project 1			Project 2																																																																																
	Outgo	Saving	NPV	Outgo	Saving	NPV																																																																														
0	15.0	0	=-15.0	14.0	0	= -14																																																																														
1	0	4.0	$= (4 / (1+.12)^1$ $= 3.571$	0.2	3.5	$= (3.3 / (1+.12)^1$ $= 2.95$																																																																														
2	0.5	4.0	$= (3.5 / (1+.12)^2$ $= 2.79$	0.2	3.5	$= (3.3 / (1+.12)^2$ $= 2.63$																																																																														
3	0	4.0	$= (4 / (1+.12)^3$ $= 2.84$	0.2	3.5	$= (3.3 / (1+.12)^3$ $= 2.35$																																																																														
4	0.5	4.0	$= (3.5 / (1+.12)^4$ $= 2.22$	5	3.5	$= (-1.5 / (1+.12)^4$ $= -0.95$																																																																														
5	6	4.0	$= (-2 / (1+.12)^5$ $= -1.13$	0.2	3.5	$= (3.3 / (1+.12)^5$ $= 1.87$																																																																														
6	0.5	4.0	$= (3.5 / (1+.12)^6$ $= 1.77$	0.2	3.5	$= (3.3 / (1+.12)^6$ $= 1.67$																																																																														
7	0	4.0	$= (4 / (1+.12)^7$ $= 1.81$	0.2	3.5	$= (3.3 / (1+.12)^7$ $= 1.49$																																																																														
8	0.5	9 (4+5)	$= (8.5 / (1+.12)^8$ $= 3.43$	0.2	5.5 (3.5+2)	$= (5.3 / (1+.12)^8$ $= 2.14$																																																																														
NPV			= + 2.301	@12%		= + 0.15																																																																														
L- 6	<p>A project activity has several components as indicated below;</p> <table border="1" style="width:100%; border-collapse: collapse; text-align: center;"> <thead> <tr> <th>S. No.</th> <th>Activity</th> <th>Preceded by</th> <th>Duration (in Weeks)</th> </tr> </thead> <tbody> <tr><td>1</td><td>A</td><td>-</td><td>8</td></tr> <tr><td>2</td><td>B</td><td>A</td><td>6</td></tr> <tr><td>3</td><td>C</td><td>A</td><td>12</td></tr> <tr><td>4</td><td>D</td><td>B</td><td>4</td></tr> <tr><td>5</td><td>E</td><td>D</td><td>5</td></tr> <tr><td>6</td><td>F</td><td>B</td><td>12</td></tr> <tr><td>7</td><td>G</td><td>E &amp; F</td><td>9</td></tr> <tr><td>8</td><td>H</td><td>C</td><td>8</td></tr> <tr><td>9</td><td>I</td><td>F &amp; H</td><td>5</td></tr> <tr><td>10</td><td>J</td><td>I &amp; G</td><td>6</td></tr> </tbody> </table> <p style="margin-top: 20px;">d. Prepare a PERT chart, estimate the duration of the project and identify the critical path.</p>	S. No.	Activity	Preceded by	Duration (in Weeks)	1	A	-	8	2	B	A	6	3	C	A	12	4	D	B	4	5	E	D	5	6	F	B	12	7	G	E & F	9	8	H	C	8	9	I	F & H	5	10	J	I & G	6																																							
S. No.	Activity	Preceded by	Duration (in Weeks)																																																																																	
1	A	-	8																																																																																	
2	B	A	6																																																																																	
3	C	A	12																																																																																	
4	D	B	4																																																																																	
5	E	D	5																																																																																	
6	F	B	12																																																																																	
7	G	E & F	9																																																																																	
8	H	C	8																																																																																	
9	I	F & H	5																																																																																	
10	J	I & G	6																																																																																	

**Paper 1 –Set A with Solutions**

- e. What are the Earliest Start, Latest Start and Total Float of activity 'H'?
- f. What would be the project duration if activity 'H' got delayed by 3 weeks?


Ans

**PERT Diagram based on Activity on Arrow**

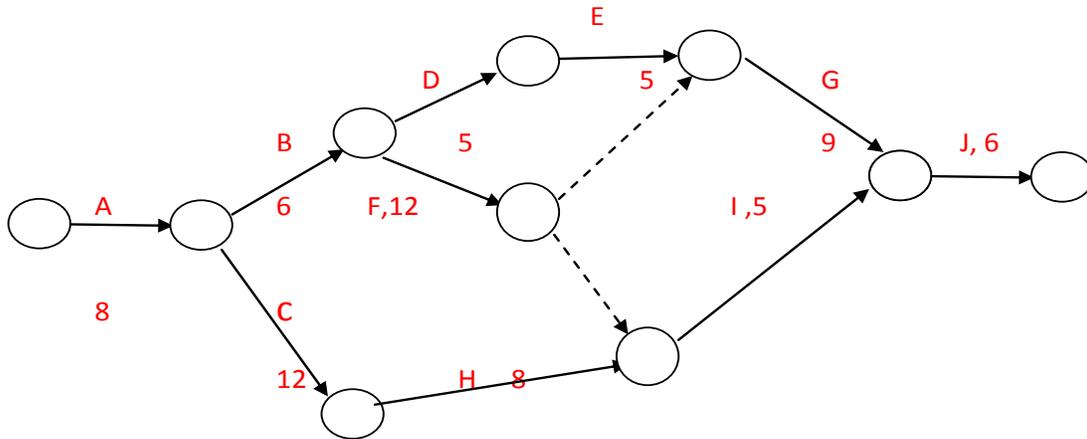

OR

**PERT Diagram based on Activity on Node**

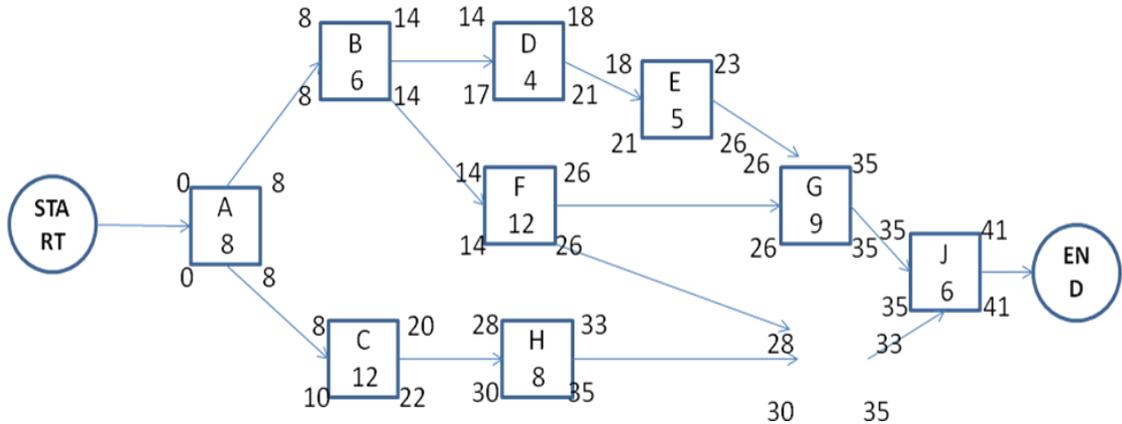

.....6 marks

a. Critical Path: A-B-F-G-J

.....1 mark

b. Estimated Project Duration: 41 weeks

**Paper 1 –Set A with Solutions**

	.....1 mark
c. For activity H, Early Start is 20, Latest Start is 22 and Total Float is 2 weeks.	.....1 mark
d. Project duration will be 42 weeks- a delay of 1 week.	.....1 mark

..... **End of Section – III** .....